

DEMOLITION NOTES

PLANS DO NOT ATTEMPT TO SHOW ALL ELECTRICAL DEMOLITION ITEMS. UNLESS OTHERWISE NOTED, THE DEVICES ARE SHOWN FOR INFORMATIONAL PURPOSES. FIELD VERIFY ALL DEMOLITION ITEMS AND PROVIDE REMOVAL OF ALL DEVICES ACCORDINGLY.

REMOVE ALL LIGHT FIXTURES, IN THE DEMOLITION AREAS. REMOVE CONDUIT/WIRE NOT BEING REUSED. CARE SHALL BE TAKEN TO MAINTAIN CIRCUIT CONTINUITY TO ELECTRICAL DEVICES THAT SHALL REMAIN. PROVIDE NEW CONDUIT/WIRE AS REQUIRED.

DAMAGE TO EXISTING MATERIALS/EQUIPMENT WILL BE REPAIRED AT NO ADDITIONAL COST TO OWNER. RE-SUPPORT ANY REMAINING CONDUIT OR DEVICES THAT WERE SUPPORTED BY WALLS/MILLWORK BEING REMOVED.

NON-DEMOLITION AREAS: ALL DUPLEX RECEPTACLES AND ALL SPECIAL SYSTEMS SHALL REMAIN. DEMOLITION WORKS SHALL NOT AFFECT AREAS NOT INCLUDED IN DEMOLITION. CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTINUITY OF ALL SERVICES IN NON-DEMOLITION AREAS. MAINTAIN SERVICE BY EXTENDING, RE-ROUTING AND/OR RECONNECTING ANY CIRCUITS AFFECTED BY DEMOLITION. PROVIDE ADDITIONAL CONDUIT/WIRE AS REQUIRED TO MAINTAIN SERVICE.

FIELD INVESTIGATE THE EXISTING ELECTRICAL INSTALLATION. ALL EXISTING INSTALLATIONS IN THE RENOVATION AREAS THAT ARE TO REMAIN BUT ARE NOT CURRENTLY IN COMPLIANCE WITH CURRENT CODES SHALL BE CORRECTED, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

UN-SUPPORTED CONDUIT AND JUNCTION BOXES LAYING ON TOP OF CEILING TILES, CONDUIT AND/OR JUNCTION BOXES SUPPORTED ONLY BY TIE-WIRE - RAISE AND SUPPORT CONDUIT WITH STRAP PER SPECS. PROVIDE NEW CONDUIT/WIRE AS REQUIRED. CIRCUITS WITHOUT A SEPARATE GREEN GROUNDING WIRE - INSTALL A GREEN GROUNDING WIRE FOR EVERY RECEPTACLE OUTLET AND DEVICES. INSTALLATION OF THE GREEN GROUNDING WIRE MAY REQUIRE THE REMOVAL AND RE-INSTALLATION OF THE EXISTING WIRES. PROVIDE NEW WIRE AS REQUIRED.

ALL EXISTING ABANDONED AND/OR UN-USED CONDUIT/WIRE, SWITCHES/STARTERS, JUNCTION BOXES, AND DEVICES IN PROJECT AREAS SHALL BE REMOVED BACK TO PANELS AND/OR CONTROL PANELS. ALL ITEMS DEMOLISHED SHALL BE REMOVED BACK TO PANELS AND/OR CONTROL PANELS.

PRIOR TO STARTING OF DEMOLITION, CONFER WITH ARCHITECT FOR GENERAL INSTRUCTIONS.

SEAL ALL PENETRATIONS IN EXISTING FLOORS, CEILINGS, WALLS, ETC., WHERE ELECTRICAL EQUIPMENT, DEVICES, CABLING, ETC., ARE REMOVED TO SATISFACTION OF ARCHITECT.


DETERMINE ALL EXISTING AND NEW DEVICE CIRCUIT DESIGNATIONS ON THE RECORD DRAWINGS.

WHERE REMOVAL OF EXISTING ELECTRICAL APPARATUS INTERRUPTS A CIRCUIT SERVING EXISTING DOWNSTREAM DEVICES OR FIXTURES TO REMAIN, MAINTAIN CIRCUIT CONTINUITY AS REQUIRED. PROVIDE NEW JUNCTION BOXES, PULLBOXES, RACEWAYS, WIRING, ETC., AS REQUIRED.

WHERE AN EXISTING DEVICE OR LIGHT FIXTURE IS REMOVED BUT THE RACEWAY AND BOX REMAINS FOR CIRCUIT CONTINUITY, PROVIDE AN APPROPRIATE BLANK COVER PLATES OF MATERIAL AND FINISH TO MATCH THE COVER PLATES ON THE DEVICES IN THAT ROOM.

WHERE AN EXISTING ELECTRICAL DEVICE, EQUIPMENT, ETC., IS BEING REMOVED FROM AN EXISTING WALL AND THAT WALL IS TO REMAIN, CONTRACTOR SHALL PATCH EXISTING WALL TO ARCHITECTS SATISFACTION.

SEAL ALL EXISTING PENETRATIONS THRU FIRE RATED WALLS, FLOORS, ETC. WITH FIREPROOFING MATERIAL EQUAL OR GREATER THAN FIRE RATING OF WALLS, FLOORS, ETC.

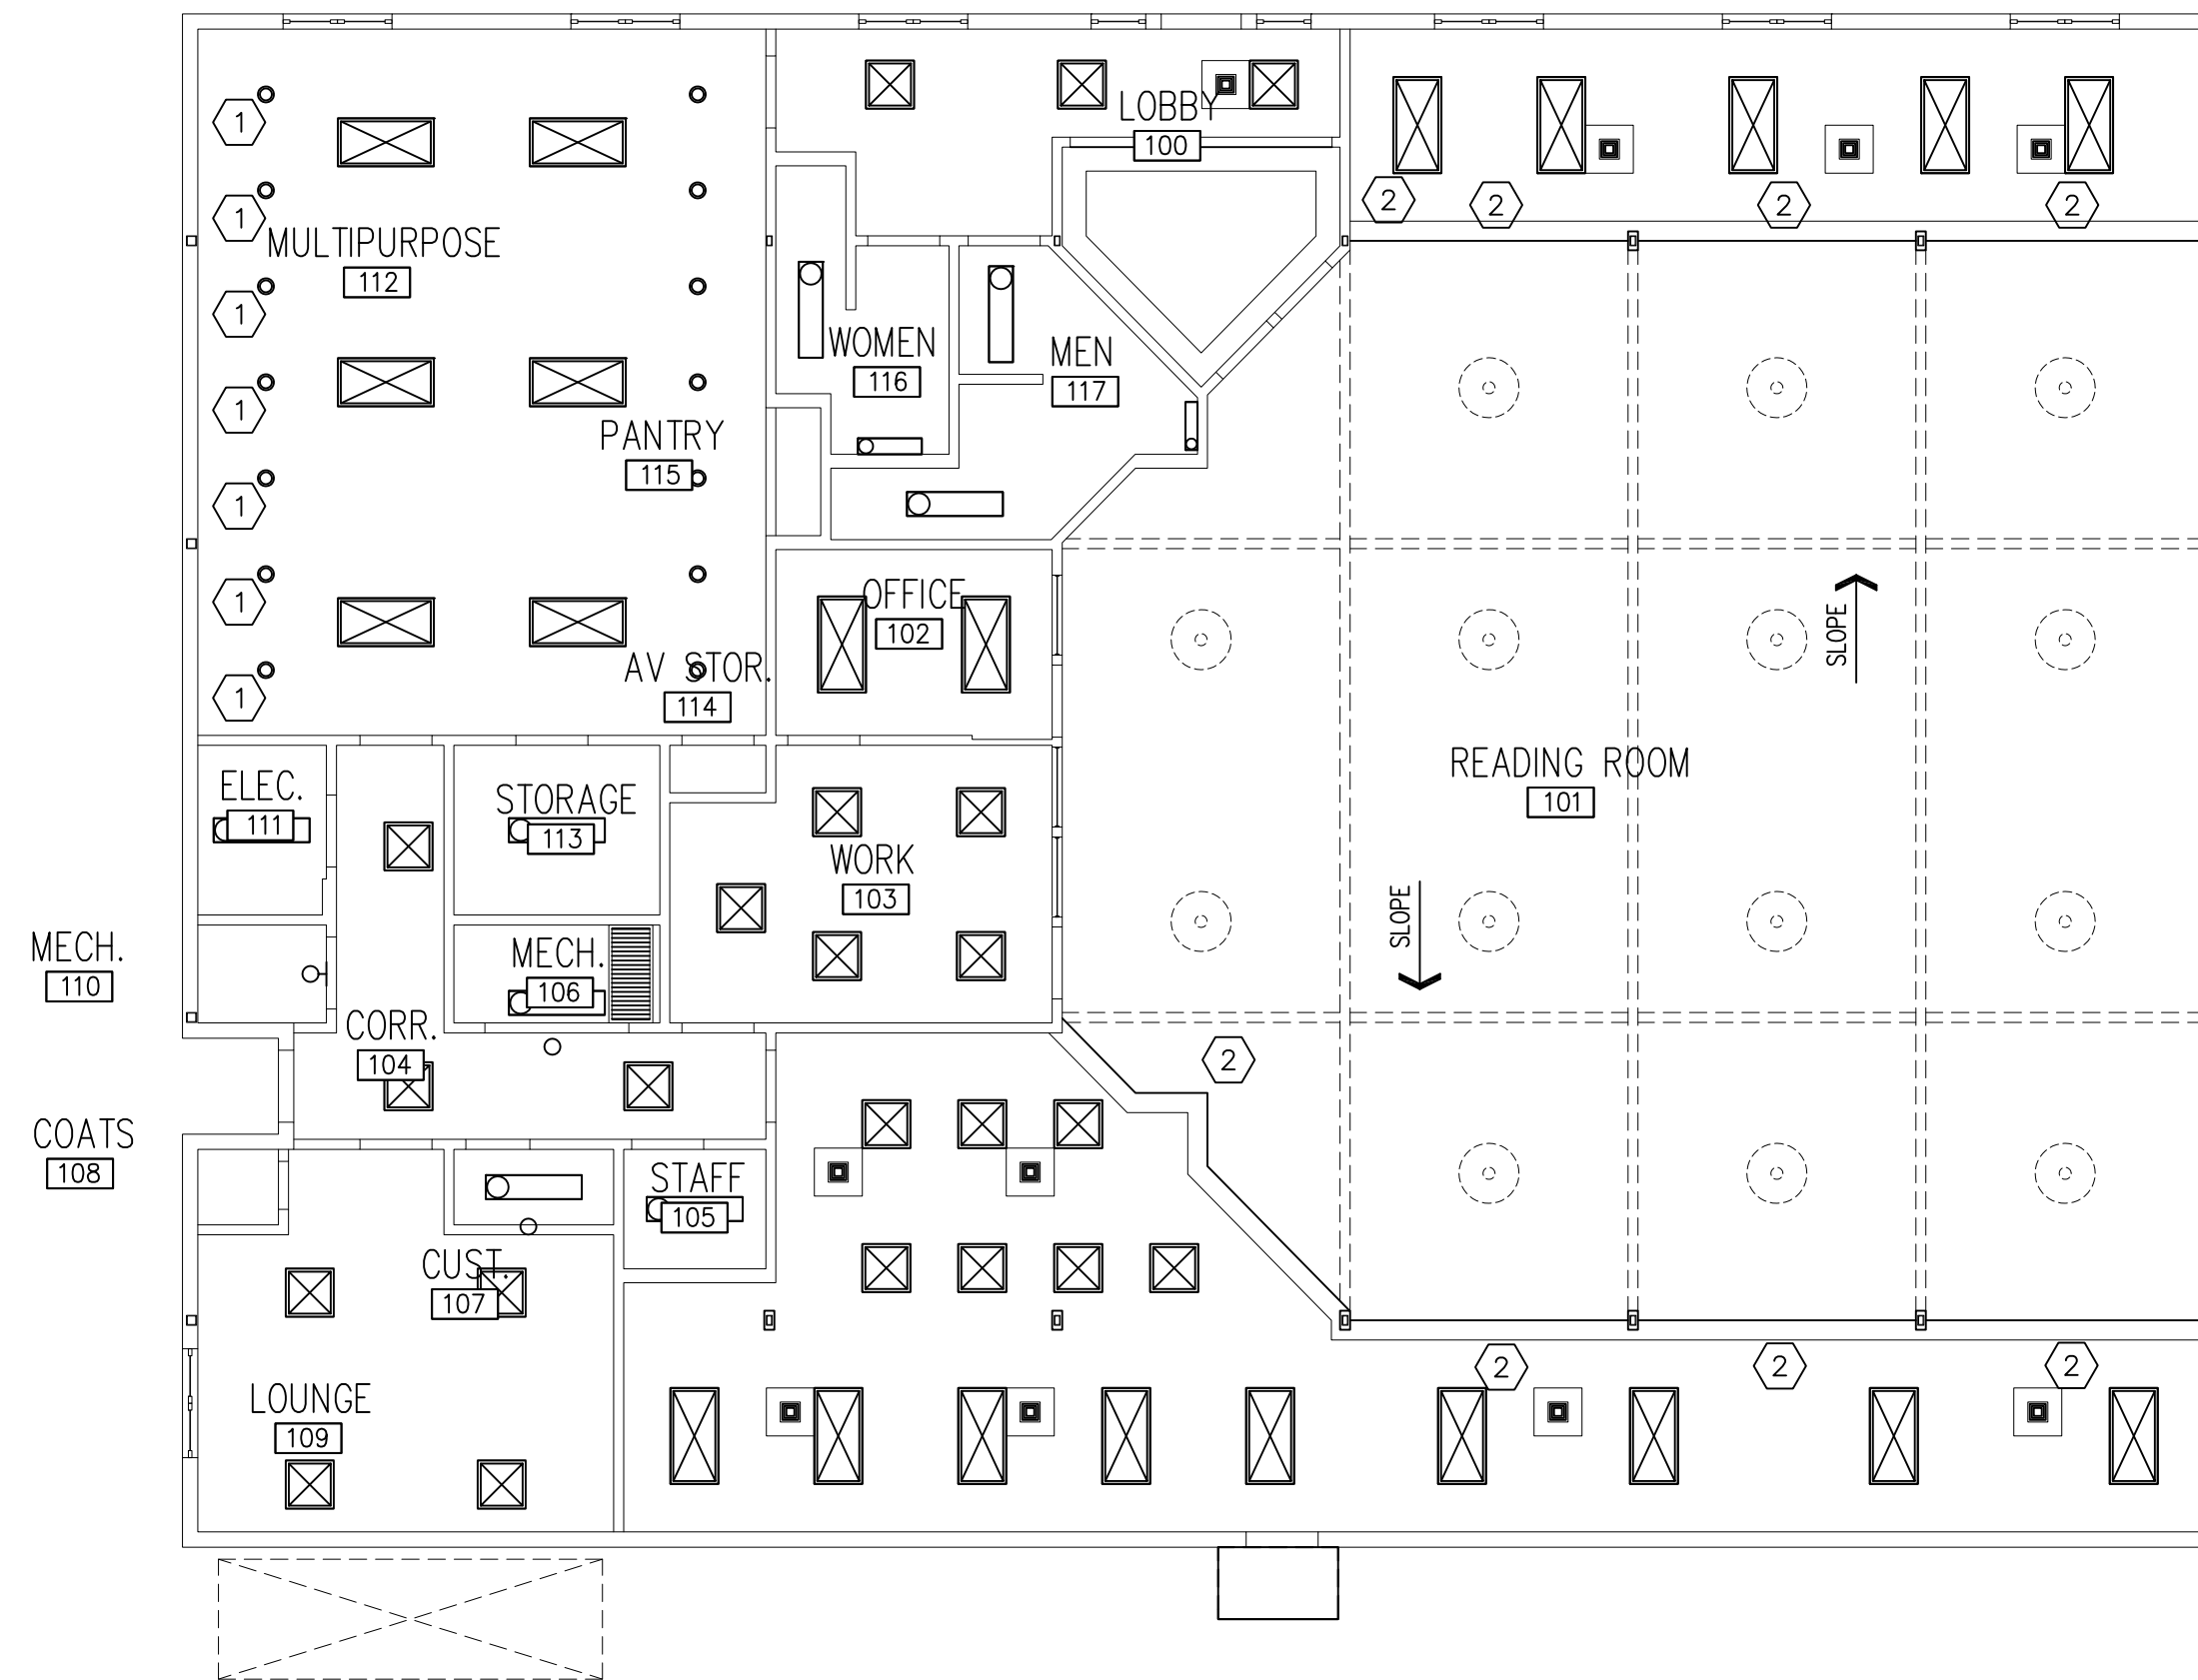

1 ELECTRICAL DEMOLITION PLAN E-1


scale: 1/8" = 1'-0"

SPECIFIC NOTES THIS SHEET:

- 1 EXISTING FIXTURE TO REMAIN.
- 2 APPROXIMATE LOCATION OF REMOTE BALLASTS TO BE REMOVED. THERE IS ONE BALLAST FOR EACH PENDANT/CIRCULAR FIXTURE SHOWN.

GENERAL NOTES THIS SHEET

- A. REMOVE EXISTING LIGHTING AS SHOWN ON THE ARCHITECTURAL DRAWINGS.
- B. EXISTING FIRE ALARM DEVICES, SPECIAL SYSTEMS DEVICES, EMERGENCY FIXTURES, AND EXIT SIGNS SHALL REMAIN AND BE PROTECTED THROUGHOUT CONSTRUCTION.

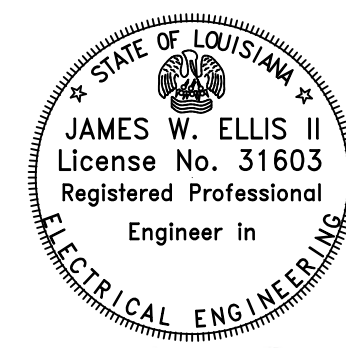

02/06/15

J. W. Ellis II

ELLIS ENGINEERING, L.L.C.	108 ROYAL CRESCENT DR. BELLE CHASSE, LA 70037 (504) 415-7670
	PROJECT No. 14017
JAMES W. ELLIS II, P.E., LOUISIANA LICENSE # 31603	

BURGDahl & GRAVES
A.I.A. ARCHITECTS
A PROFESSIONAL CORPORATION · PHONE (504) 566-4433

RENOVATIONS TO
LIVE OAK LIBRARY
 FOR
JEFFERSON PARISH
 125 ACADIA DRIVE
 WAGGAMAN, LA

DATE: 01.30.2015
DRAWN BY:
REVISIONS:

E-1

SHEET 11 OF 13